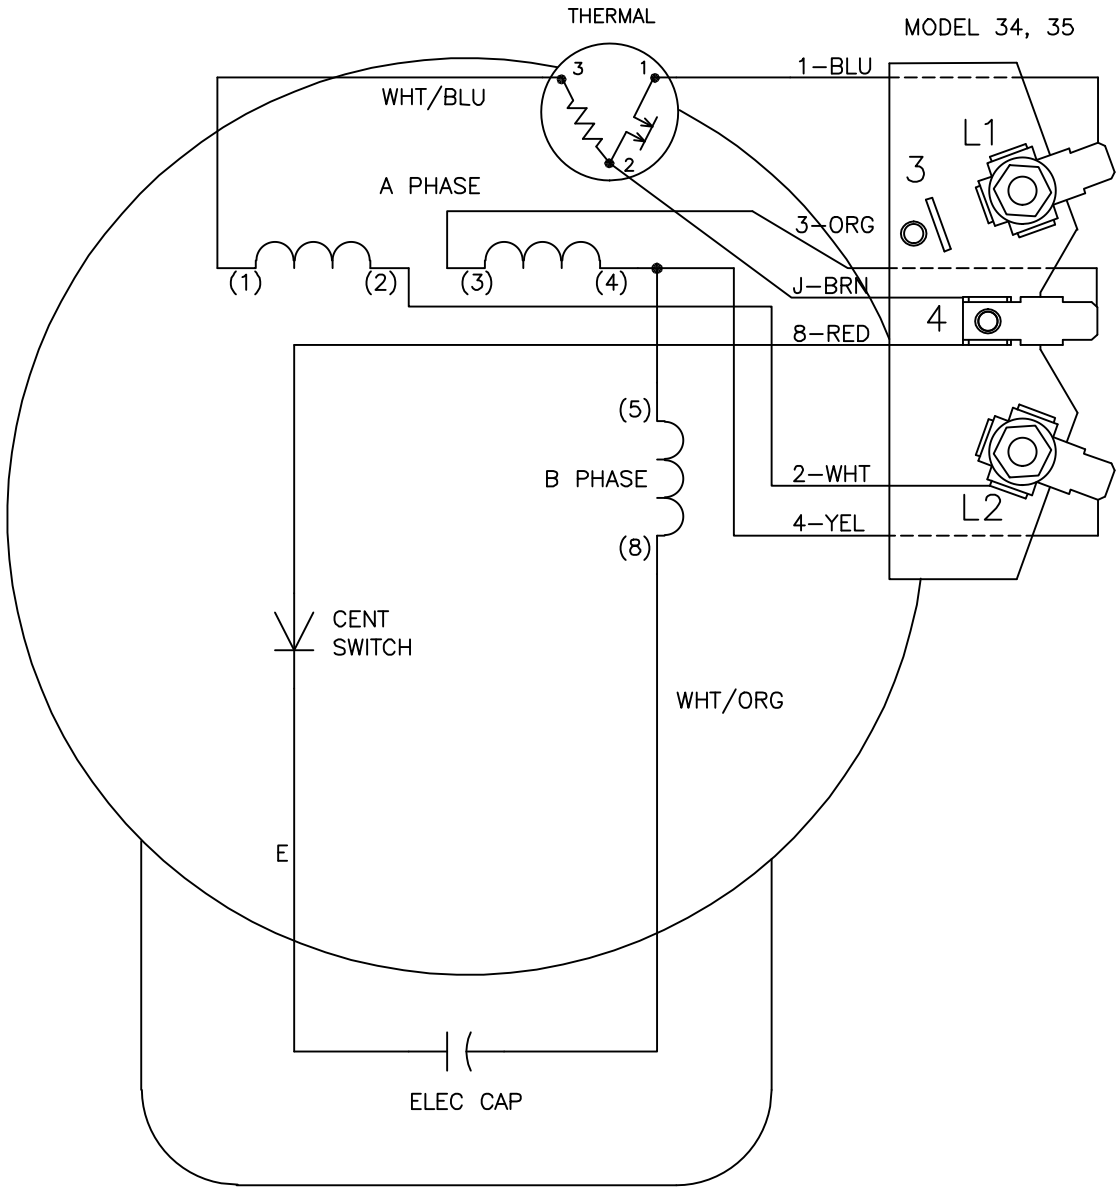

NOTES:

1. CONNECT LINE LEADS TO L1 AND L2.

   LOW VOLTAGE: CONNECT AS SHOWN.

   HIGH VOLTAGE: MOVE LEAD J TO TERM. 3.
   MOVE LEAD 2 TO TERM. 4.

2. CONNECTIONS ARE SHOWN FOR STANDARD ROTATION (CCW FACING END OPPOSITE SHAFT EXTENSION). INTERCHANGE 5 AND 8 INTERNALLY FOR OPPOSITE STANDARD ROTATION.

3. MULTIPLE CAPACITORS ARE CONNECTED IN PARALLEL UNLESS OTHERWISE SPECIFIED.

4. LEAD COLORS ARE OPTIONAL. LEADS MUST ALWAYS BE NUMBERED AS SHOWN.

CD0203

REV. DESC: REMOVE MODEL 17 CONNECTION		
REV. LTR: G	VERSION: 02	TDR: 000001250682
FILE: \AAA\00007\108	REVISED: 12:29:47 04/16/2025	BY: ENBRIR0
MTL: –		

BALDOR - RELIANCE®

TYPE L, DV, FIX, THERMAL, TERMINAL PLATE

SH 1 of 1