


ABB BALDOR RELIANCE III

Customer information packet

031371

56DBSS-3-MA-230/460 VAC 6

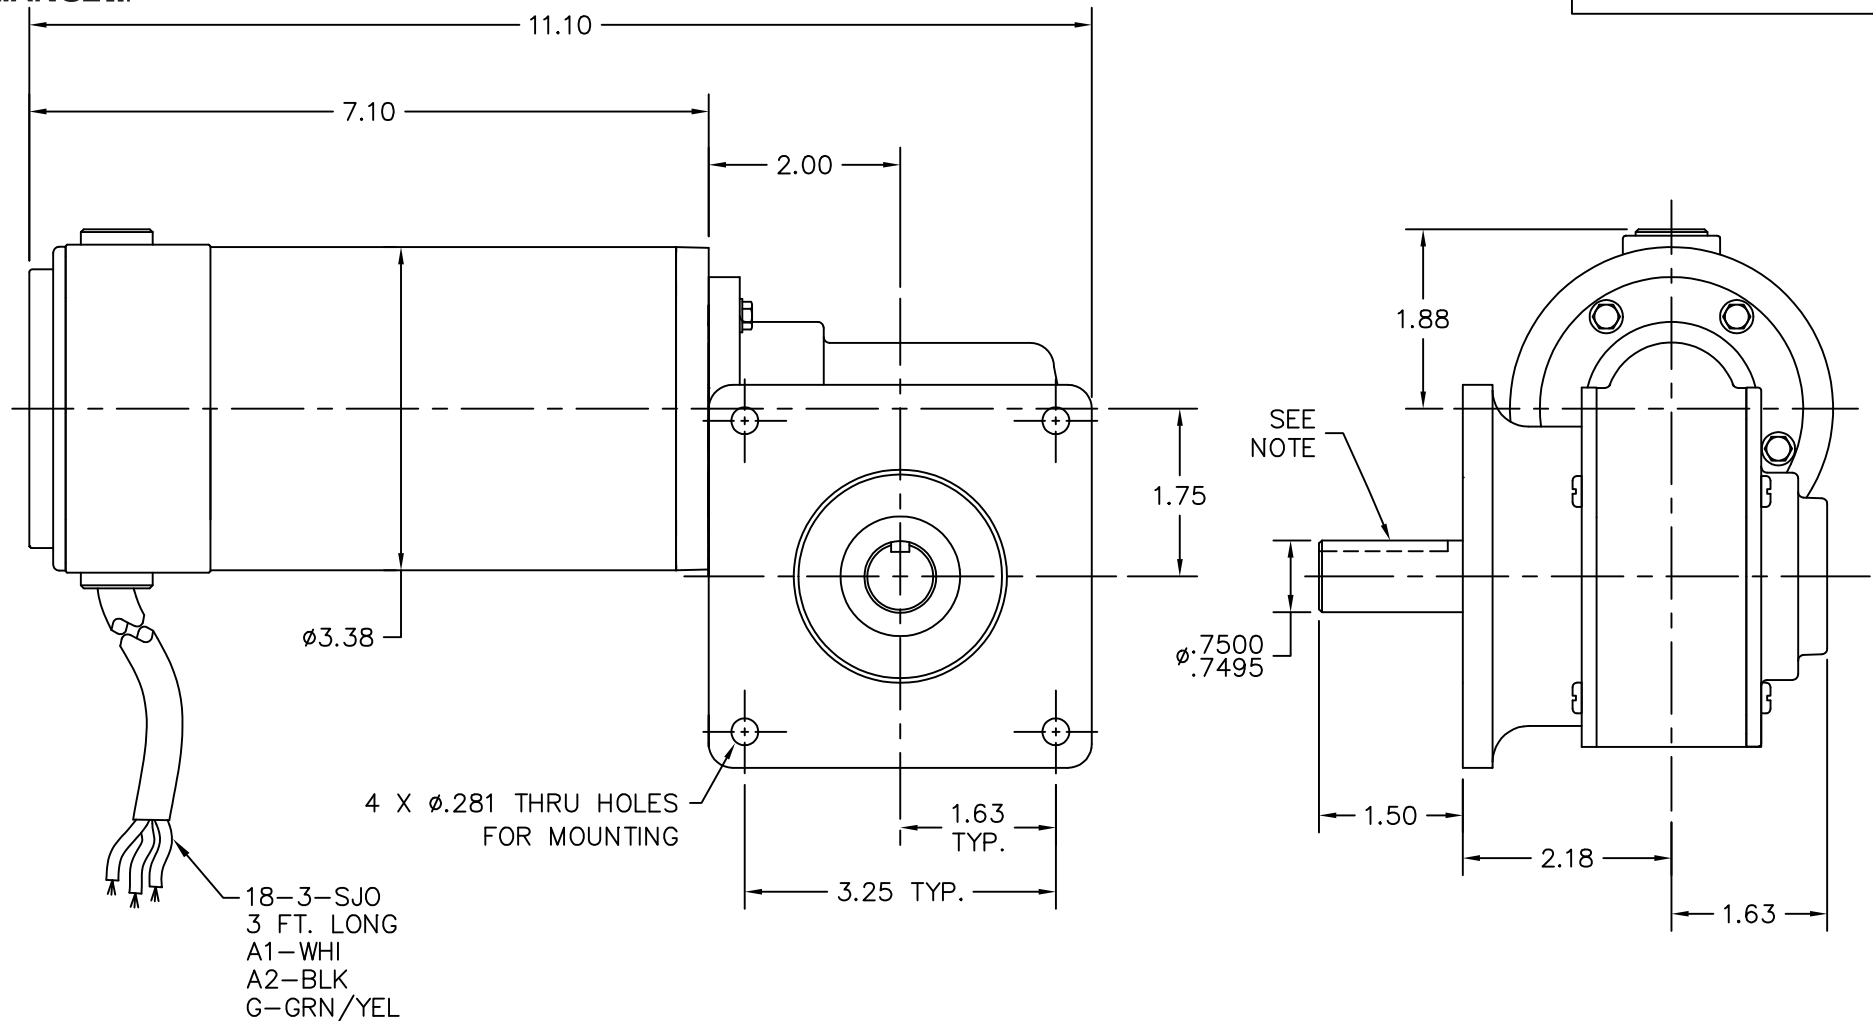

CUST. NAME

CUST. P.O.

CERTIFIED BY

MODEL

INSUL

AMB

H.P.

MTG

TYPE

R.P.M.

VOLTS

ENCL

PHASE

FREQ

FRAME

REV. DESC: INACTIVATED. REPLACED BY 31371A.

REV. LTR: A

BY: YYP

REVISED: 02/09/00 13:2

TDR: 0198388

FILE: CKA00011082

MDL: -

MTL: -

BALDOR ELECTRIC Co.

LAYOUT,1K JAF TENV GP NONE .75 1.50 KEY