
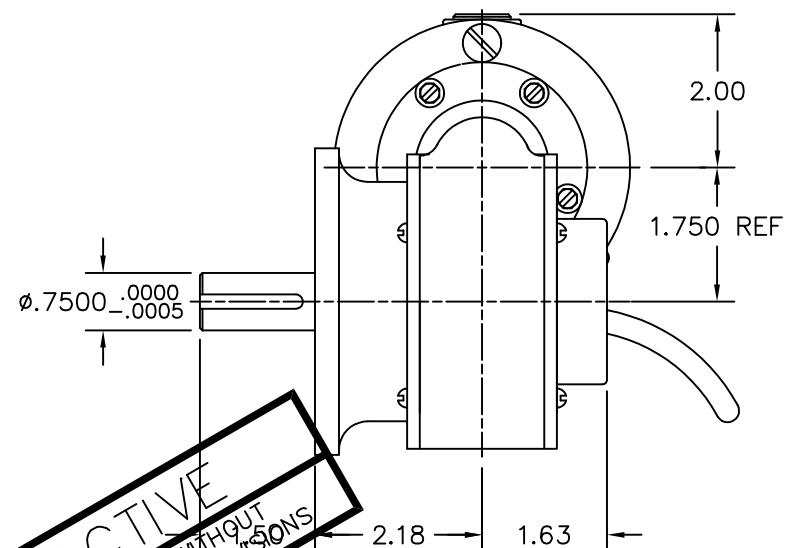


ABB BALDOR RELIANCE III

Customer information packet

031419

140DBSS-6-MA-230/460 VAC

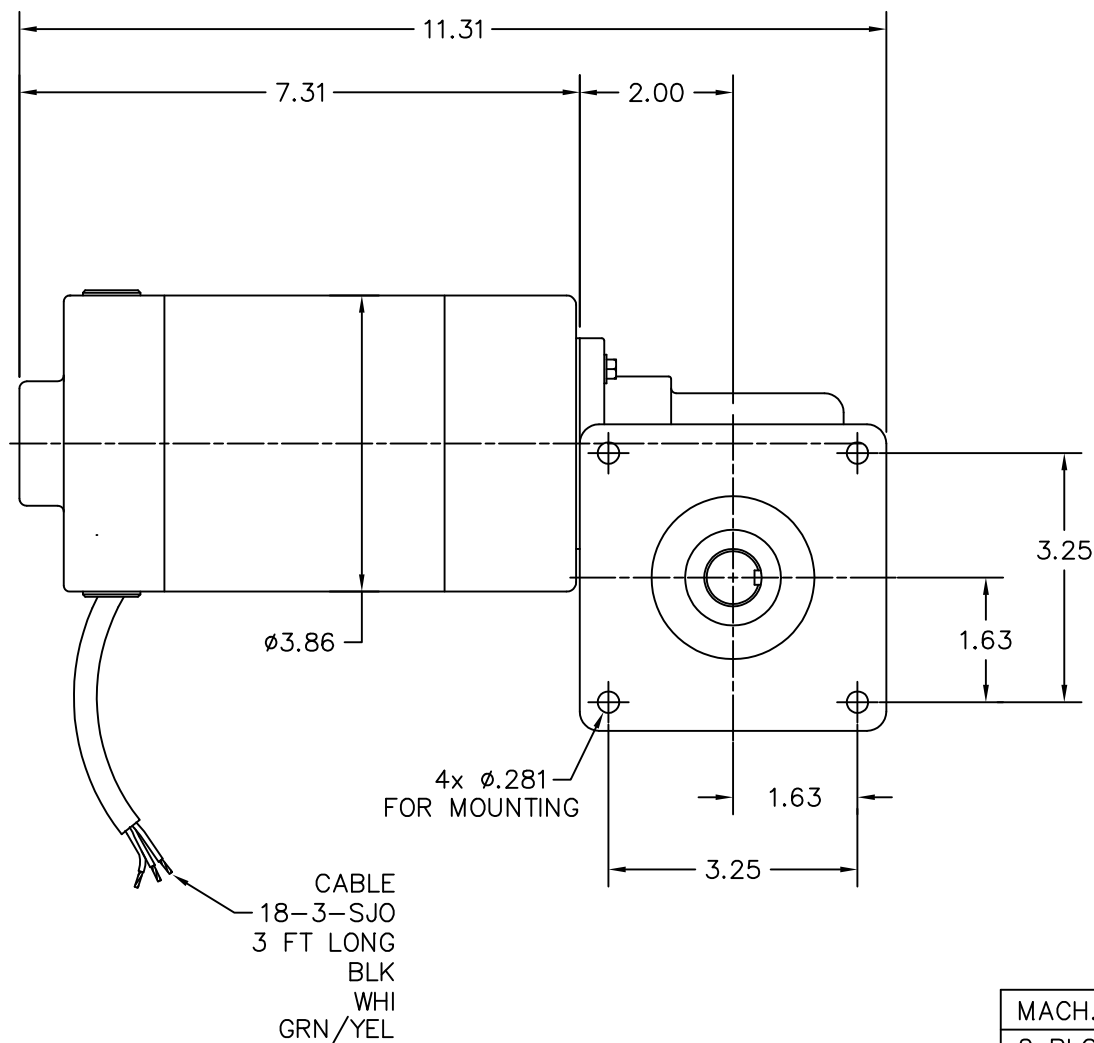

INACTIVE
DO NOT USE WITHOUT
UPDATING ALL REVISIONS

MACH. TOL UNLESS SPEC.
2 PLC DECIMALS = $\pm$.010
3 PLC DECIMALS = $\pm$.005
ANG= $\pm$.5° RADII=.015 $\pm$.005

KEYWAY: .187 X .093 X 1.250

CUST. NAME		CUST. P.O.		CERTIFIED BY		MODEL		INSUL		AMB							
H.P.		MTG		TYPE		R.P.M.		VOLTS		ENCL		PHASE		FREQ		FRAME	
REV. DESC: REPLACED W/ 31419A TO USE TANG COMM								BALDOR ELECTRIC Co.									
REV. LTR: E		BY: YYP		REVISED: 08/01/00 17:		TDR: 0213749											
61419				FILE: CKA00003838		MDL: -		LAYOUT,74 JAF TENV GP NONE									
				MTL: -													

Page 2